


# Quality of Water in the Vaal Barrage Reservoir

Date Sampled 17 July 2019

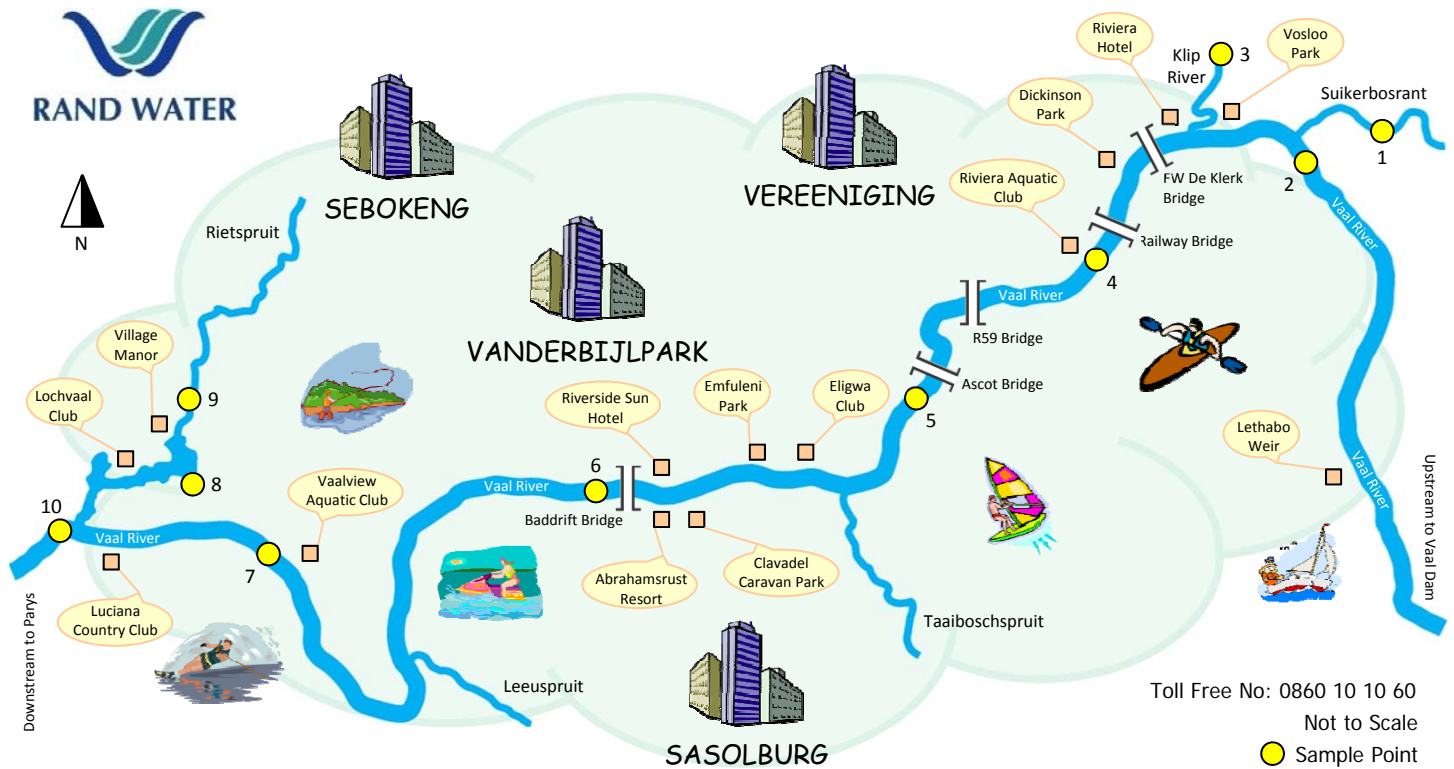

Interpretation of the results obtained from water samples collected at the respective sample points (refer map above).

<b><i>Escherichia coli</i> (<i>E.coli</i>)</b> Predicted symptoms include: Skin irritations, infections & intestinal disorders*	<i>E.coli</i> counts per 100ml at sample points									
	1	2	3	4	5	6	7	8	9	10
	This Week	91	21	866	10,500	1,414	69	2	64,880	122,300
Last Week	365	65	22,240	46,110	911	26	1	4,480	111,990	1,046
Guideline	Low risk of gastrointestinal disorders <i>E.coli</i> < 130 counts/100ml			Slight risk of gastrointestinal disorders <i>E.coli</i> 130 - 200 counts/100ml		Significant risk of gastrointestinal disorders <i>E.coli</i> 200 - 400 counts/100ml			High risk of gastrointestinal disorders <i>E.coli</i> > 400 counts/100ml	

<b>Blue Green Algae</b> Predicted symptoms include: Skin irritations, infections & intestinal disorders*	Blue Green algae counts at sample points									
	1	2	3	4	5	6	7	8	9	10
	This Week	241	345	1,448	250	4,947	< 40	724	3,620	1,448
Last Week	151	724	724	460	1,207	483	603	2,051	241	965
Guideline	Low Risk Blue Green algae < 20,000 cells/ml			Moderate Risk Blue Green algae 20,000 - 100,000 cells/ml			High Risk Blue Green algae > 100,000 cells/ml			

<b>Algal Pigments</b> Predicted nuisance conditions include: Scums & smells	Algal pigments expressed as Chlorophyll-a levels at sample points									
	1	2	3	4	5	6	7	8	9	10
	This Week	< 2	< 2	2	< 2	8	405	24	16	15
Last Week	1	0	5	4	15	4	55	56	21	62
Guideline	Low Risk Chlorophyll-a < 15ug/l			Moderate Risk Chlorophyll-a 15 - 30ug/l			High Risk Chlorophyll-a > 30ug/l			

\* If ingested. X Sample not received / no data available. Reports generated every Friday of the year.

DISCLAIMER: Although Rand Water has made every endeavour to make an accurate assessment of the parameters described above (based on published South African and international criteria), neither Rand Water, nor any of its officials, shall be responsible for any damage or health related problems that may result due to the use of the Vaal Barrage Reservoir for any purpose.