


# Quality of Water in the Vaal Barrage Reservoir

Date Sampled 19 June 2019

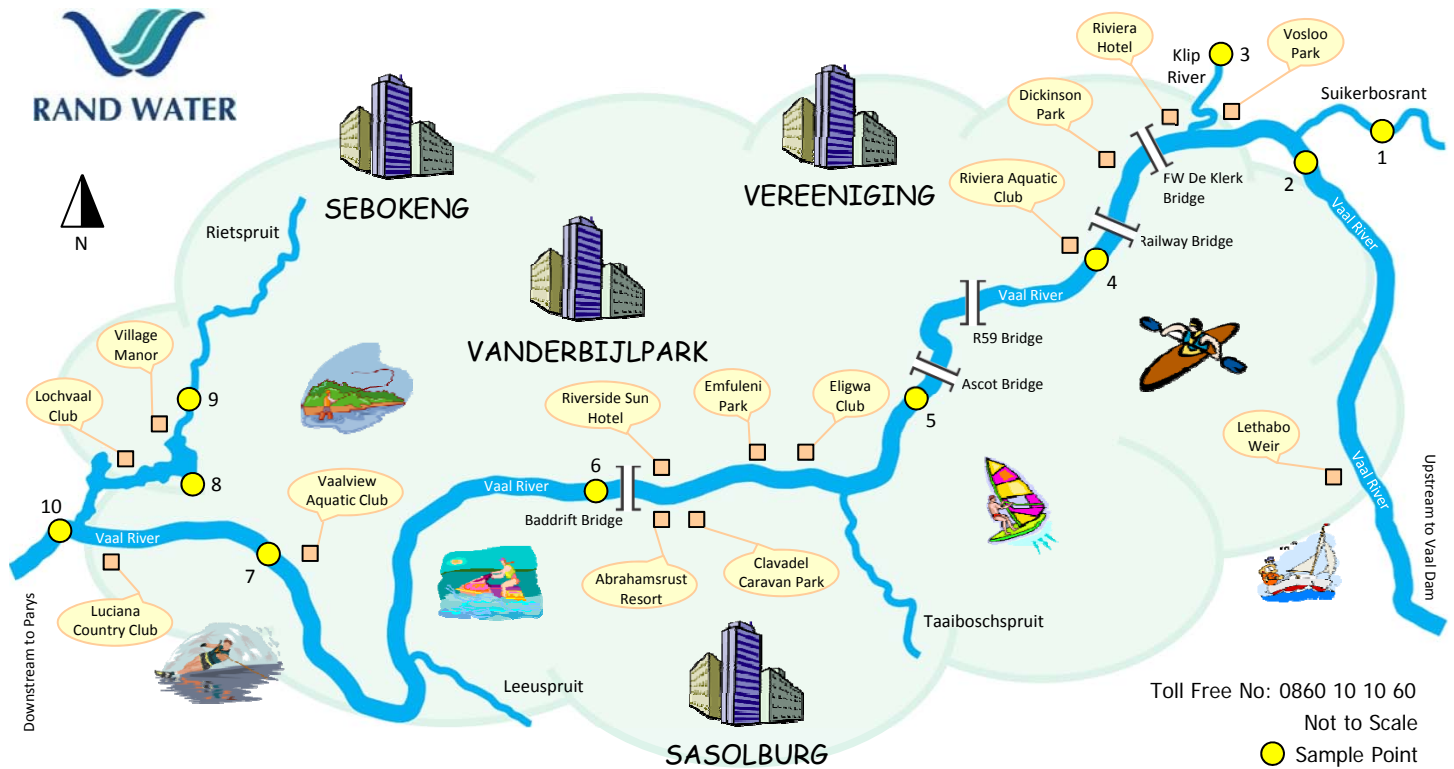

Interpretation of the results obtained from water samples collected at the respective sample points (refer map above).

<b>Escherichia coli (E.coli)</b> Predicted symptoms include: Skin irritations, infections & intestinal disorders*	<b>E.coli counts per 100ml at sample points</b>									
	1	2	3	4	5	6	7	8	9	10
	This Week	81	91	2,420	23,820	697	26	22	866	14,140
Last Week	121	15	29,090	5,460	387	8	21	8,620	68,670	7
Guideline	Low risk of gastrointestinal disorders <i>E.coli</i> < 130 counts/100ml			Slight risk of gastrointestinal disorders <i>E.coli</i> 130 - 200 counts/100ml		Significant risk of gastrointestinal disorders <i>E.coli</i> 200 - 400 counts/100ml			High risk of gastrointestinal disorders <i>E.coli</i> > 400 counts/100ml	

<b>Blue Green Algae</b> Predicted symptoms include: Skin irritations, infections & intestinal disorders*	<b>Blue Green algae counts at sample points</b>									
	1	2	3	4	5	6	7	8	9	10
	This Week	483	40	1,724	377	241	80	362	603	603
Last Week	483	724	2,181	724	778	< 40	603	1,810	4,585	2,172
Guideline	Low Risk Blue Green algae < 20,000 cells/ml			Moderate Risk Blue Green algae 20,000 - 100,000 cells/ml			High Risk Blue Green algae > 100,000 cells/ml			

<b>Algal Pigments</b> Predicted nuisance conditions include: Scums & smells	<b>Algal pigments expressed as Chlorophyll-a levels at sample points</b>									
	1	2	3	4	5	6	7	8	9	10
	This Week	1	5	8	10	16	5	26	35	24
Last Week	1	1	2	2	6	5	54	196	40	108
Guideline	Low Risk Chlorophyll-a < 15ug/l			Moderate Risk Chlorophyll-a 15 - 30ug/l			High Risk Chlorophyll-a > 30ug/l			

\* If ingested. X Sample not received / no data available. Reports generated every Friday of the year.

DISCLAIMER: Although Rand Water has made every endeavour to make an accurate assessment of the parameters described above (based on published South African and international criteria), neither Rand Water, nor any of its officials, shall be responsible for any damage or health related problems that may result due to the use of the Vaal Barrage Reservoir for any purpose.